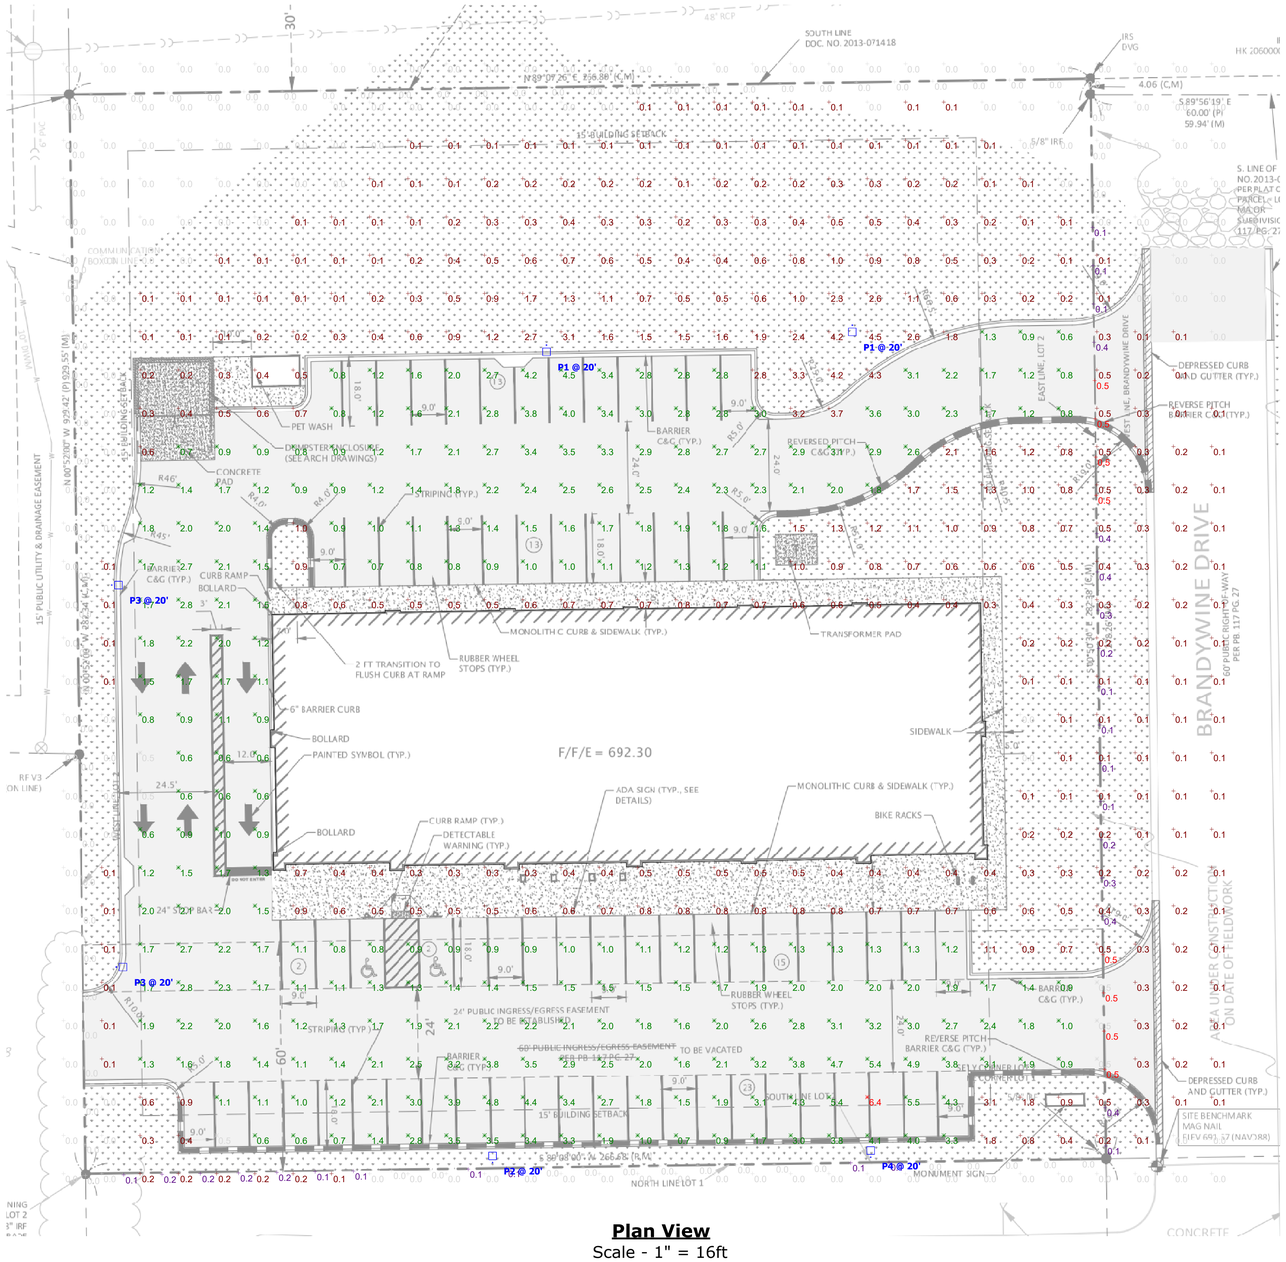

Plan View
Scale - 1" = 16ft

Schedule

Symbol	Label	Quantity	Manufacturer	Catalog Number	Description	Number Lamps	Lumens Per Lamp	Light Loss Factor	Wattage
	P1	2	Lithonia Lighting	DSX1 LED P6 40K 80CRI T4M	D-Series Size 1 Area Luminaire P6 Performance Package 4000K CCT 80 CRI Type 4 Medium	1	19126	0.93	165.25
	P2	1	Lithonia Lighting	DSX1 LED P6 40K 80CRI BLC4	D-Series Size 1 Area Luminaire P6 Performance Package 4000K CCT 80 CRI Type 4 Extreme Backlight Control	1	14158	0.93	165.25
	P3	2	Lithonia Lighting	DSX1 LED P2 40K 80CRI BLC3	D-Series Size 1 Area Luminaire P2 Performance Package 4000K CCT 80 CRI Type 3 Extreme Backlight Control	1	6516	0.93	67.79
	P4	1	Lithonia Lighting	DSX1 LED P8 40K 80CRI BLC4	D-Series Size 1 Area Luminaire P8 Performance Package 4000K CCT 80 CRI Type 4 Extreme Backlight Control	1	19321	0.93	215.77

Statistics

Description	Symbol	Avg	Max	Min	Max/Min	Avg/Min
Complete Site	+	0.9 fc	6.4 fc	0.0 fc	N/A	N/A
Parking - Drive Lanes	X	1.9 fc	6.4 fc	0.5 fc	12.8:1	3.8:1
Property Line	+	0.1 fc	0.5 fc	0.0 fc	N/A	N/A

NOTES:
1. CALCULATION POINT WORK PLANE: GRADE LEVEL
2. FIXTURE MOUNTING HEIGHT: REFER TO FIXTURE LABELS NOTED ON PLAN
3. CALCULATIONS PROVIDED BY KSA ARE NOT A GUARANTEE OF PERFORMANCE. ACTUAL LIGHT LEVELS MAY VARY.**

KSA LIGHTING & CONTROLS

Anytime Fitness - Lowell, IN - V1

Designer JM
Date 01/07/2025
Scale Not to Scale
Version No. 001
Summary

**This document contains confidential and proprietary information of KSA Lighting & Controls. This document may only be used by or for the benefit of KSA Lighting & Controls representatives and customers. This lighting layout is not a professional engineering drawing and is provided for informational purposes only, without warranty as to accuracy, completeness, reliability or otherwise. KSA Lighting & Controls is not responsible for specifying the light fixtures or illumination requirements for any specific project, nor is it responsible for meeting municipal or building code requirements. It is the obligation of the end-user to consult with a professional engineering advisor to determine whether this lighting layout meets the applicable project requirements for lighting system performance, safety, suitability and effectiveness for use in a particular application. Field verification is recommended when calculations are based on end-user or customer-provided information. End-user environment and application (including, but not limited to, voltage variation and dirt accumulation) can cause actual field performance to differ from the calculated photometric performance represented in this lighting layout. In no event will KSA Lighting & Controls be responsible for any loss resulting from any use of this drawing.